


C.I.P.**6,5 x 54 Mauser**

TAB. I

Date 84-06-14

Pays d'origine: DE

Révision 02-05-15

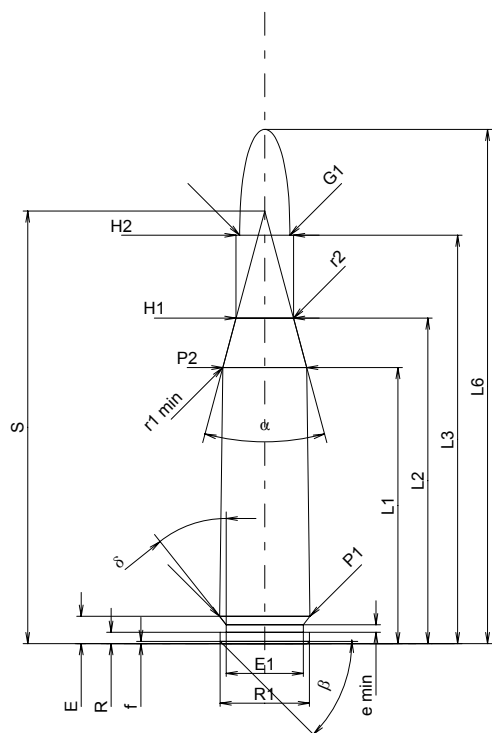**CARTOUCHE MAXI****Longueurs**

L1 ¹⁾ *	=	36.50	-0.20
L2 ¹⁾ *	=	43.05	-0.20
L3 ¹⁾	=	54.00	
L4	=		
L5	=		
L6	=	68.00	

Culot

R	=	1.50	
R1	=	11.80	
R3	=		
E	=	3.60	
E1	=	10.20	
e min	=	1.00	
delta	=	38°30'	
f	=	0.30	
beta	=	45°	

Chambre à poudre

P1	=	11.95	
P2 ¹⁾ *	=	11.10	-0.20

Cône de raccordement

alpha	=	29°59'56"	
S	=	57.21	
r1 min	=	0.50	
r2	=	0.50	

Collet

H1 *	=	7.59	
H2 ¹⁾	=	7.59	

Projectile

G1 ¹⁾	=	6.64	
G2	=		
F	=		
L3+G ¹⁾	=	68.00	

Pressions (Énergies)**Méthode transducteur**

Pmax	=	3050 bar	
PK	=	3508 bar	
PE	=	3810 bar	
M	=	25.00	
EE	=	2380 Joule	

Autres indications

Fe ¹⁾	=	0.15	
delta L	=		

CHAMBRE MINI**Longueurs**

L1 *	=	36.44	
L2 *	=	42.99	
L3 ¹⁾	=	54.30	

Cuvette

R	=	1.50	
R1	=	11.85	
R2	=		
R3	=		
r	=		

Chambre à poudre

E	=	3.60	
P1 ¹⁾	=	11.98	
P2 *	=	11.13	

Cône de raccordement

alpha ¹⁾	=	29°59'56"	
S	=	57.21	
r1 max	=	0.50	
r2	=	0.50	

Collet

H1 *	=	7.62	
H2 ¹⁾	=	7.61	

Prise de rayures


G1 ¹⁾ *	=	6.68	
G ¹⁾ *	=	14.00	
alpha1	=	180°	
h	=		
s	=		
i ¹⁾	=	0°34'22"	
w	=		

Canon

F ¹⁾ *	=	6.40	
Z ¹⁾	=	6.64	

Rayures

b	=	3.50	
N	=	4	
u	=	200.00	
Q	=	33.94	mm ²

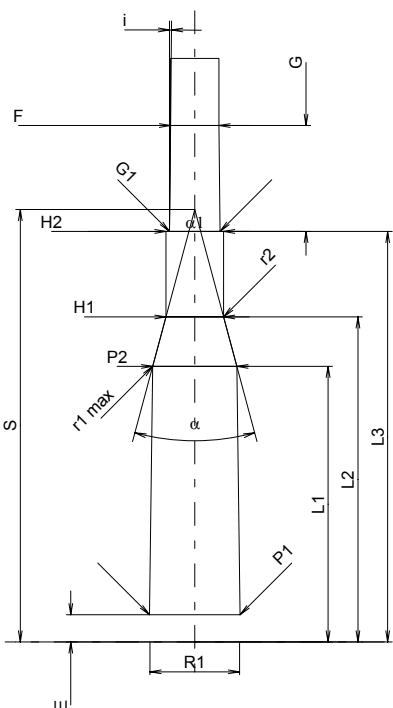

Échelle 1:1

Dimensions en << mm >>
Dimensions et tolérances pour les canons
d'épreuve: Voyez Annexe CR 1.

Notes: 1) A' contrôler pour la sécurité
* Dimensions de base