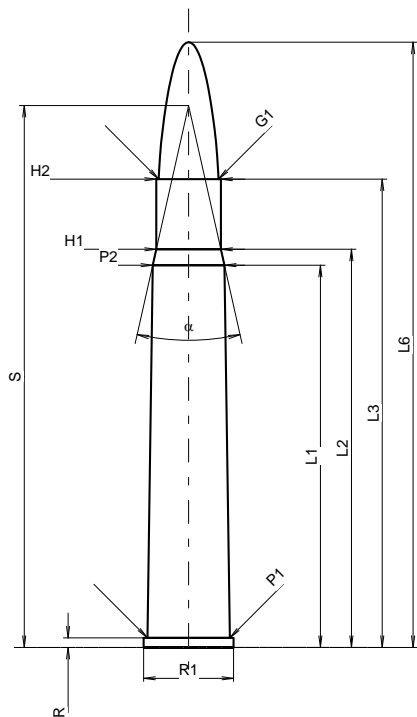


C.I.P.**375 Fl. Mag. N.E.**

TAB.	II
Date	84-06-14
Révision	13-05-22

Pays d'origine: GB

Marquage alternatif: 375 H&H Fl. Mag. N.E.

**CARTOUCHE MAXI****Longueurs**

L1 *	=	60.96
L2 *	=	63.50
L3 ¹⁾	=	74.68
L4	=	
L5	=	
L6	=	96.52

Culot

R ¹⁾	=	1.52	-0.25
R1	=	14.35	
R3	=		
E	=		
E1	=		
e min	=		
δ	=		
f	=		
β	=		

Chambre à poudre

P1	=	13.13
P2 *	=	11.43

Cône de raccordement

α	=	25°17'47"
S	=	86.43
r1 min	=	
r2	=	

Collet

H1 *	=	10.29
H2 ¹⁾	=	10.29

Projectile

G1 ¹⁾	=	9.52
G2	=	
F	=	
L3+G ¹⁾	=	83.15

Pressions (Énergies)**Méthode transducteur**

Pmax	=	3250 bar
PK	=	3738 bar
PE	=	4060 bar
M	=	25.00
EE	=	5925 Joule

Autres indications

Fe ¹⁾⁴⁾	=	0.15
delta L	=	

CHAMBRE MINI**Longueurs**

L1 *	=	60.99
L2 *	=	63.53
L3 ¹⁾	=	74.93

Cuvette

R ¹⁾	=	1.55
R1	=	14.78
R2	=	
R3	=	
r	=	

Chambre à poudre

E	=	
P1 ¹⁾	=	13.16
P2 *	=	11.46

Cône de raccordement

α	=	25°30'39"
S	=	86.30
r1 max	=	
r2	=	

Collet

H1 *	=	10.31
H2 ¹⁾	=	10.31

Prise de rayures


G1 ¹⁾ *	=	9.58
G ¹⁾ *	=	8.47
α1	=	90°
h *	=	0.37
s	=	
i ¹⁾	=	1°10'
w	=	

Canon

F ¹⁾ *	=	9.25
Z ¹⁾	=	9.50

Rayures

b	=	2.92
N	=	6
u	=	406.00
Q	=	69.43 mm ²

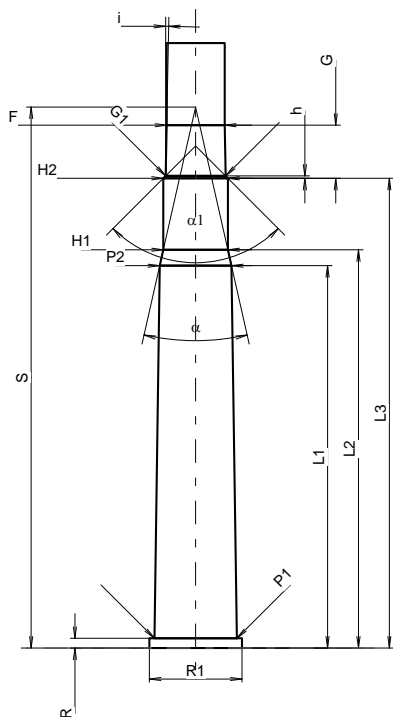

Échelle 1:1.21

Dimensions en << mm >>
Dimensions et tolérances pour les canons
d'épreuve: Voyez Annexe CR 1.

Notes: 1) A' contrôler pour la sécurité
4) Feuillure sur la bourrelet
* Dimensions de base