


C.I.P.**6,5 x 51 R (Arisaka)**

TAB. II

Date 84-06-14

Révision 13-05-22

Pays d'origine: JP

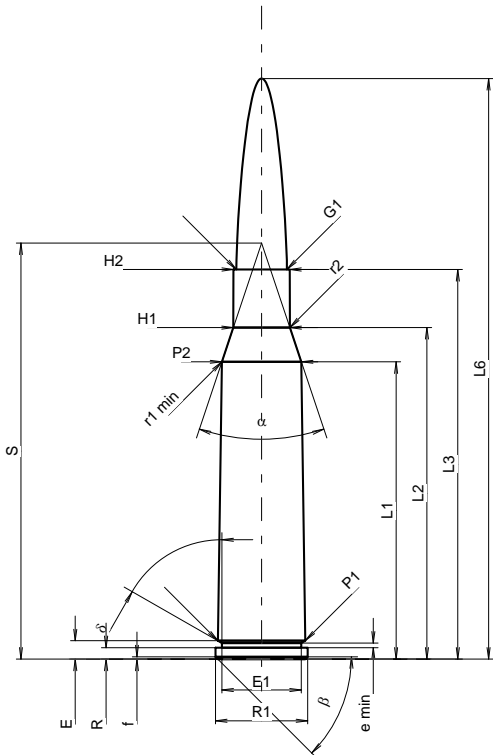**CARTOUCHE MAXI****Longueurs**

L1	=	38.92
L2	=	43.40
L3 ¹⁾	=	51.00
L4	=	
L5	=	
L6	=	76.00

Culot

R ¹⁾	=	1.50	-0.25
R1	=	12.08	
R3	=		
E	=	2.40	
E1	=	10.40	
e min	=	0.60	
delta	=	60°	
f	=	0.30	
beta	=	45°	

Chambre à poudre

P1	=	11.45
P2 *	=	10.40

Cône de raccordement

alpha *	=	37°
S *	=	54.46
r1 min	=	0.50
r2	=	0.50

Collet

H1 *	=	7.40
H2 ¹⁾	=	7.37

Projectile

G1 ¹⁾	=	6.63
G2	=	
F	=	
L3+G ¹⁾	=	69.50

Pressions (Énergies)**Méthode transducteur**

Pmax	=	2950 bar
PK	=	3393 bar
PE	=	3688 bar
M	=	25.00
EE	=	2625 Joule

Autres indications

Fe ¹⁾⁴⁾	=	0.15
delta L	=	

CHAMBRE MINI**Longueurs**

L1	=	38.93
L2	=	43.38
L3 ¹⁾	=	51.50

Cuvette

R ¹⁾	=	1.50
R1	=	12.12
R2	=	
R3	=	
r	=	

Chambre à poudre

E	=	
P1 ¹⁾	=	11.48
P2 *	=	10.43

Cône de raccordement

alpha *	=	37°
S *	=	54.51
r1 max	=	0.50
r2	=	0.50

Collet

H1 *	=	7.45
H2 ¹⁾	=	7.40

Prise de rayures


G1 ^{1)*)}	=	6.69
G ¹⁾	=	18.50
alpha 1	=	90°
h *	=	0.35
s	=	
i ^{1)*)}	=	0°34'05"
w	=	

Canon

F ^{1)*)}	=	6.33
Z ¹⁾	=	6.63

Rayures

b	=	3.50
N	=	4
u	=	200.00
Q	=	33.69 mm ²

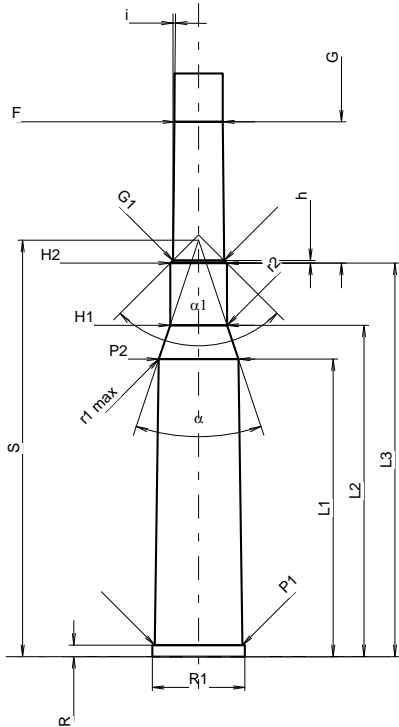

Échelle 1.01:1

Dimensions en << mm >>
Dimensions et tolérances pour les canons
d'épreuve: Voyez Annexe CR 1.

Notes: 1) A' contrôler pour la sécurité
4) Feuillure sur la bourrelet
* Dimensions de base