

C.I.P.**6 x 62 R Freres**

TAB.

II


Date

92-02-27

Pays d'origine: DE

Révision

02-05-15

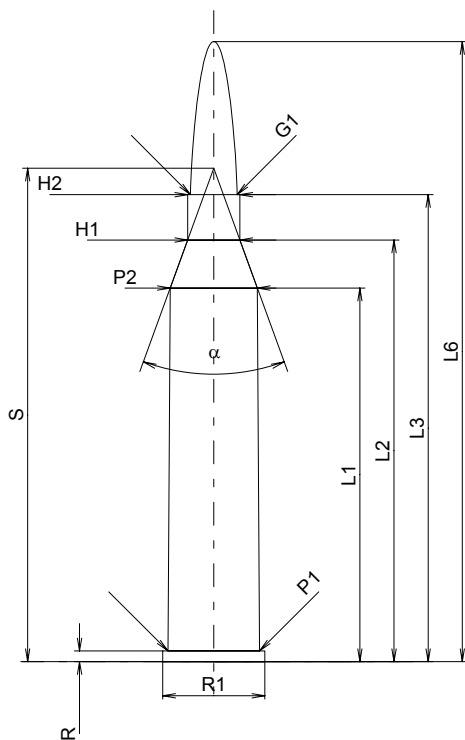**CARTOUCHE MAXI****Longueurs**

L1 *	=	49.40
L2 *	=	55.75
L3 ¹⁾	=	61.75
L4	=	
L5	=	
L6	=	82.00

Colot

R ¹⁾	=	1.40	-0.25
R1	=	13.50	
R3	=		
E	=		
E1	=		
e min	=		
delta	=		
f	=		
beta	=		

Chambre à poudre

P1	=	12.12
P2 *	=	11.53

Cône de raccordement

alpha	=	39°58'50"
S	=	65.25
r1 min	=	
r2	=	

Collet

H1 *	=	6.91
H2 ¹⁾	=	6.91

Projectile

G1 ¹⁾	=	6.18
G2	=	
F	=	
L3+G ¹⁾	=	68.42

Pressions (Énergies)**Méthode transducteur**

Pmax	=	4300 bar
PK	=	4945 bar
PE	=	5375 bar
M	=	25.00
EE	=	3435 Joule

Autres indications

Fe ¹⁾	=	0.10
delta L	=	

CHAMBRE MINI**Longueurs**

L1 *	=	49.40
L2 *	=	55.72
L3 ¹⁾	=	62.00

Cuvette

R ¹⁾	=	1.40
R1	=	13.55
R2	=	
R3	=	
r	=	

Chambre à poudre

E	=	
P1 ¹⁾	=	12.14
P2 *	=	11.55

Cône de raccordement

alpha	=	39°59'42"
S	=	65.27
r1 max	=	
r2	=	

Collet

H1 *	=	6.95
H2 ¹⁾	=	6.93

Prise de rayures


G1 ¹⁾ *	=	6.19
G ¹⁾ *	=	6.67
alpha1	=	180°
h	=	
s *	=	2.97
i ¹⁾	=	1°19'
w	=	

Canon

F ¹⁾ *	=	6.02
Z ¹⁾	=	6.17

Rayures

b	=	1.73
N	=	6
u	=	260.00
Q	=	29.25 mm ²

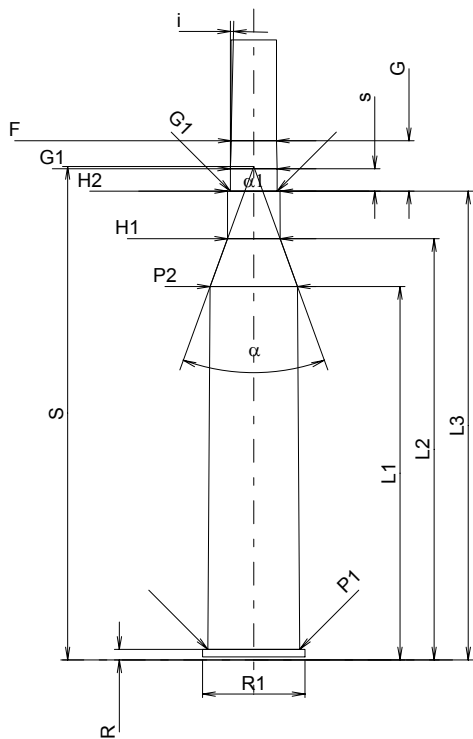

Échelle 1:1

Dimensions en << mm >>
Dimensions et tolérances pour les canons
d'épreuve: Voyez Annexe CR 1.

Notes: 1) A' contrôler pour la sécurité
* Dimensions de base