


C.I.P.**8,5 x 63 R**

TAB. II

Date 92-02-27

Pays d'origine: DE

Révision 21-04-07

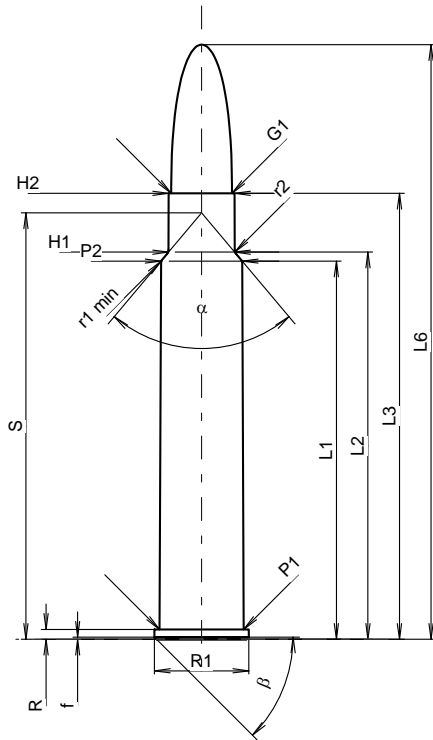**CARTOUCHE MAXI****Longueurs**

L1 *	=	53.42
L2 *	=	54.69
L3 ¹⁾	=	63.00
L4	=	
L5	=	
L6	=	84.00

Culot

R ¹⁾	=	1.40	-0.25
R1	=	13.32	
R3	=		
E	=		
E1	=		
e min	=		
delta	=		
f	=	0.30	
beta	=	45°	

Chambre à poudre

P1	=	11.91
P2 *	=	11.47

Cône de raccordement

alpha	=	80°13'47"
S	=	60.23
r1 min	=	0.50
r2	=	1.00

Collet

H1 *	=	9.33
H2 ¹⁾	=	9.32

Projectile

G1 ¹⁾	=	8.59
G2	=	
F	=	
L3+G ¹⁾	=	72.00

Pressions (Énergies)**Méthode transducteur**

Pmax	=	3800 bar
PK	=	4370 bar
PE	=	4750 bar
M	=	25.00
EE	=	5145 Joule

Autres indications

Fe ¹⁾⁴⁾	=	0.15
delta L	=	

CHAMBRE MINI**Longueurs**

L1 *	=	53.40
L2 *	=	54.67
L3 ¹⁾	=	63.55

Cuvette

R ¹⁾	=	1.40
R1	=	13.37
R2	=	
R3	=	
r	=	

Chambre à poudre

E	=	
P1 ¹⁾	=	11.94
P2 *	=	11.50

Cône de raccordement

alpha	=	80°13'47"
S	=	60.22
r1 max	=	0.50
r2	=	1.25

Collet

H1 *	=	9.36
H2 ¹⁾	=	9.35

Prise de rayures


G1 ¹⁾ *	=	8.61
G ¹⁾ *	=	9.00
alpha1	=	90°
h	=	0.37
s *	=	5.83
i ¹⁾	=	2°04'40"
w	=	

Canon

F ¹⁾ *	=	8.38
Z ¹⁾	=	8.59

Rayures

b	=	2.79
N	=	6
u	=	254.00
Q	=	56.95 mm ²

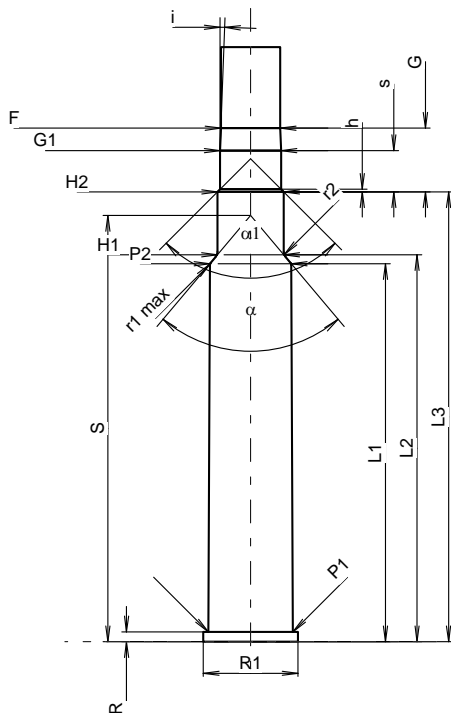

Échelle 1:1.07

Dimensions en << mm >>
Dimensions et tolérances pour les canons
d'épreuve: Voyez Annexe CR 1.

Notes: 1) A' contrôler pour la sécurité
4) Feuillure sur la bourrelet
* Dimensions de base