


C.I.P.

244 H&H Mag.

Pays d'origine: GB

TAB.	III
Date	84-06-14
Révision	02-05-15

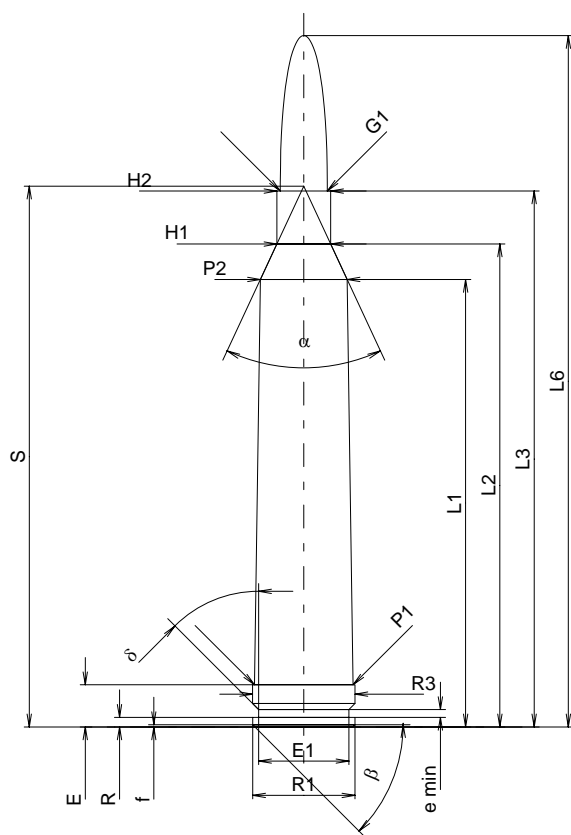

CARTOUCHE MAXI

Longueurs

L1 *	=	59.18
L2 *	=	63.87
L3 ¹⁾	=	70.87
L4	=	
L5	=	
L6	=	91.44

Culot

R	=	1.27
R1	=	13.51
R3	=	13.56
E ¹⁾	=	5.56
E1	=	11.94
e min	=	1.02
delta	=	45°
f	=	0.30
beta	=	45°

Chambre à poudre

P1	=	13.03
P2 *	=	11.48

Cône de raccordement

alpha	=	49°57'37"
S	=	71.50
r1 min	=	
r2	=	

Collet

H1 *	=	7.11
H2 ¹⁾	=	7.11

Projectile

G1 ¹⁾	=	6.22
G2	=	
F	=	
L3+G ¹⁾	=	79.13

Pressions (Énergies)

Méthode transducteur

Pmax	=	4350 bar
PK	=	5003 bar
PE	=	5438 bar
M	=	25.00
EE	=	3885 Joule

Autres indications

Fe ¹⁾	=	0.10
delta L	=	

CHAMBRE MINI

Longueurs

L1 *	=	59.18
L2 *	=	63.88
L3 ¹⁾	=	70.87

Cuvette

R	=	
R1	=	13.59
R2	=	
R3	=	13.59
r	=	

Chambre à poudre

E ¹⁾	=	5.56
P1 ¹⁾	=	13.03
P2 *	=	11.50

Cône de raccordement

alpha	=	49°39'57"
S	=	71.61
r1 max	=	
r2	=	

Collet

H1 *	=	7.15
H2 ¹⁾	=	7.14

Prise de rayures


G1 ¹⁾ *	=	6.22
G ¹⁾ *	=	8.26
alpha1	=	90°
h *	=	0.46
s	=	
i ¹⁾	=	0°44'03"
w	=	

Canon

F ¹⁾ *	=	6.02
Z ¹⁾	=	6.22

Rayures

b	=	
N	=	
u	=	255.00
Q	=	28.46 mm ²

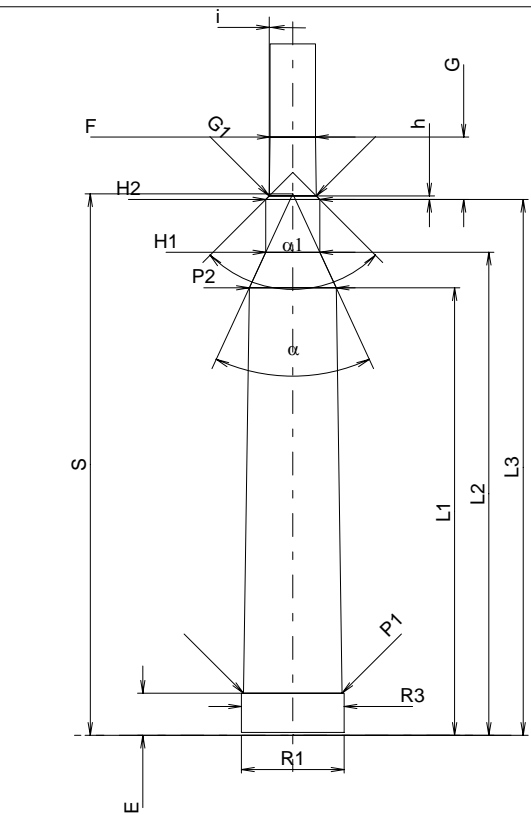

Échelle 1:1

Dimensions en << mm >>
Dimensions et tolérances pour les canons
d'épreuve: Voyez Annexe CR 1.

Notes: 1) A' contrôler pour la sécurité
* Dimensions de base