
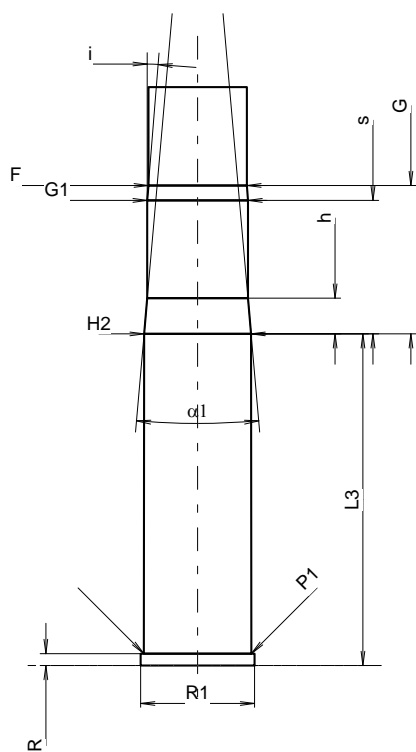


**C.I.P.****500 S&W Mag**

|          |          |
|----------|----------|
| TAB.     | IV       |
| Date     | 04-05-18 |
| Révision | 14-05-20 |

Pays d'origine: US

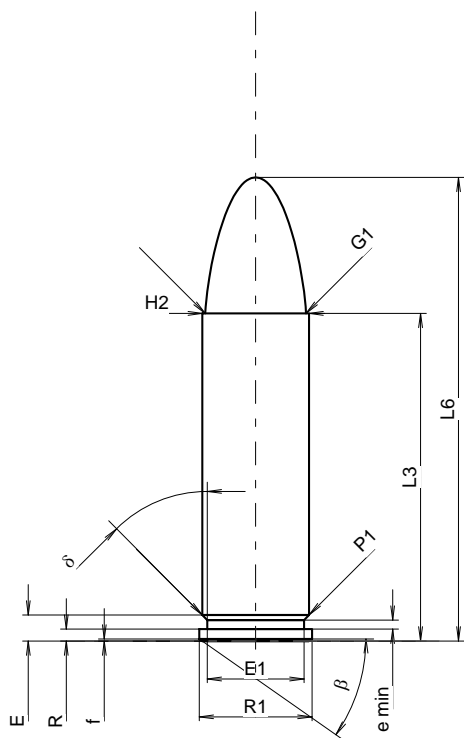

Échelle 1.05:1

**CARTOUCHE MAXI****Longueurs**

|                  |   |       |
|------------------|---|-------|
| L1               | = |       |
| L2               | = |       |
| L3 <sup>1)</sup> | = | 41.28 |
| L4               | = |       |
| L5               | = |       |
| L6               | = | 58.42 |

**Culot**

|                 |   |       |       |
|-----------------|---|-------|-------|
| R <sup>1)</sup> | = | 1.50  | -0.25 |
| R1              | = | 14.22 |       |
| R3              | = |       |       |
| E               | = | 3.28  |       |
| E1              | = | 12.19 |       |
| e min           | = | 1.14  |       |
| delta           | = | 45°   |       |
| f               | = | 0.26  |       |
| beta            | = | 35°   |       |

**Chambre à poudre**

|    |   |       |
|----|---|-------|
| P1 | = | 13.46 |
| P2 | = |       |

**Cône de raccordement**

|        |   |  |
|--------|---|--|
| alpha  | = |  |
| S      | = |  |
| r1 min | = |  |
| r2     | = |  |

**Collet**

|                  |   |       |
|------------------|---|-------|
| H1               | = |       |
| H2 <sup>1)</sup> | = | 13.46 |

**Projectile**

|                    |   |       |
|--------------------|---|-------|
| G1 <sup>1)</sup>   | = | 12.70 |
| G2                 | = |       |
| F                  | = |       |
| L3+G <sup>1)</sup> | = | 59.98 |

**Pressions (Énergies)****Méthode transducteur**

|      |   |          |
|------|---|----------|
| Pmax | = | 3700 bar |
| PK   | = | 4255 bar |
| PE   | = | 4810 bar |
| M    | = | 23.00    |

**Autres indications**

|                    |   |      |
|--------------------|---|------|
| Fe <sup>1)4)</sup> | = | 0.25 |
| delta L            | = |      |

**CHAMBRE MINI****Longueurs**

|                  |   |       |
|------------------|---|-------|
| L1               | = |       |
| L2               | = |       |
| L3 <sup>1)</sup> | = | 41.79 |

**Cuvette**

|                 |   |       |
|-----------------|---|-------|
| R <sup>1)</sup> | = | 1.50  |
| R1              | = | 14.35 |
| R2              | = |       |
| R3              | = |       |
| r               | = |       |

**Chambre à poudre**

|                  |   |       |
|------------------|---|-------|
| E                | = |       |
| P1 <sup>1)</sup> | = | 13.54 |
| P2               | = |       |

**Cône de raccordement**

|        |   |  |
|--------|---|--|
| alpha  | = |  |
| S      | = |  |
| r1 max | = |  |
| r2     | = |  |

**Collet**

|                  |   |       |
|------------------|---|-------|
| H1               | = |       |
| H2 <sup>1)</sup> | = | 13.49 |

**Prise de rayures**

|                     |   |       |
|---------------------|---|-------|
| G1 <sup>1)*</sup>   | = | 12.70 |
| G <sup>1)</sup>     | = | 18.70 |
| alpha1 <sup>*</sup> | = | 10°   |
| h                   | = | 4.51  |
| s <sup>*</sup>      | = | 16.83 |
| i <sup>1)*</sup>    | = | 4°35' |
| w                   | = |       |

**Canon**

|                  |   |       |
|------------------|---|-------|
| F <sup>1)*</sup> | = | 12.40 |
| Z <sup>1)</sup>  | = | 12.66 |

**Rayures**

|   |   |                        |
|---|---|------------------------|
| b | = | 3.30                   |
| N | = | 6                      |
| u | = | 476.30                 |
| Q | = | 123.37 mm <sup>2</sup> |

Dimensions en << mm >>  
Dimensions et tolérances pour les canons  
d'épreuve: Voyez Annexe CR 1.

Notes: 1) A' contrôler pour la sécurité  
4) Feuillure sur la bourrelet  
\* Dimensions de base